

# HID Aero™ X200 Input Monitor Module

## Supplied parts

- HID Aero X200 Input Monitor Module (1)
- Installation guide (1)
- Mounting screws (4) 0.138" × 1" (3.5 mm × 25 mm)
- Resistors (16)


## Recommended parts (not supplied)

- Certified DC power supply
- Drill with various bits for mounting hardware
- For DIN rail mounting: Brackets (2) - Phoenix Contact, USA 10 Series Rail Adapter, part number 1201578.  
Screws (4) - Self tapping, countersunk, 3.0 mm × 10 mm (or 3.0 mm × 8 mm)

CABLE REQUIREMENTS (NOT SUPPLIED)	
IO Module	One twisted pair, shielded, 24 AWG, 120Ω impedance, 4,000 ft (1,219 m) maximum
Alarm inputs	One twisted pair per input, 30Ω maximum, typically 22 AWG, 1000 ft (304.8 m)
Relay outputs	As required for the load
Power	2-conductor shielded 18 to 16 AWG, 500 ft (150 m)

## X200 Overview

The X200 has 19 total inputs, two relays, and one RS-485 port for IO module connection.

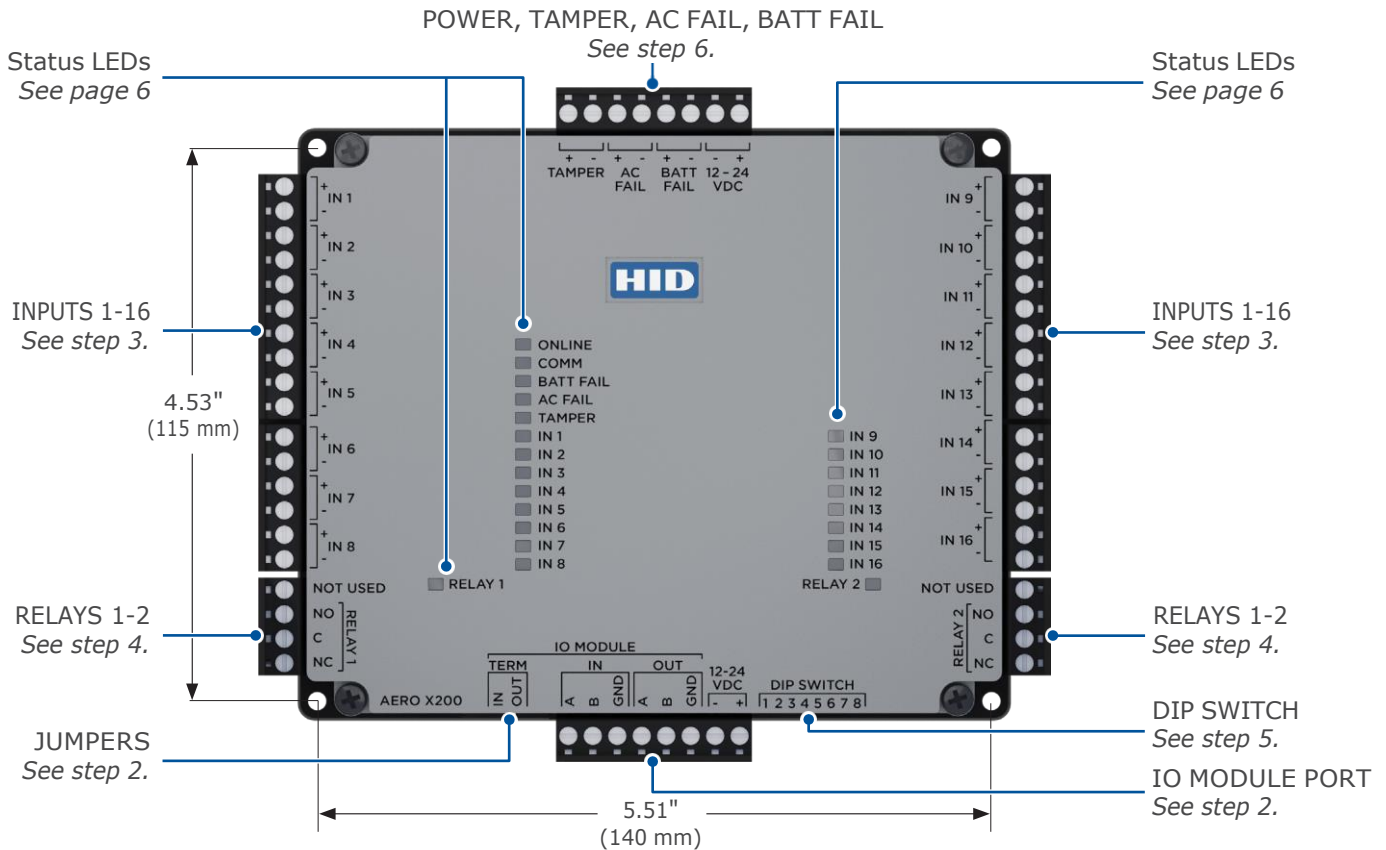

# 1. Mounting the X200




**ATTENTION**

Observe precautions for handling ELECTROSTATIC SENSITIVE DEVICES

- Always mount the controllers and interface panels in a secure area.
- Mount using the supplied screws 0.138" x 1" (3.5 mm x 25 mm).
- Alternatively mount on a DIN rail using compatible DIN rail mounting brackets and screws. See *Recommended parts*.

**Note:** The side terminal connectors must be removed to fit the mounting brackets.

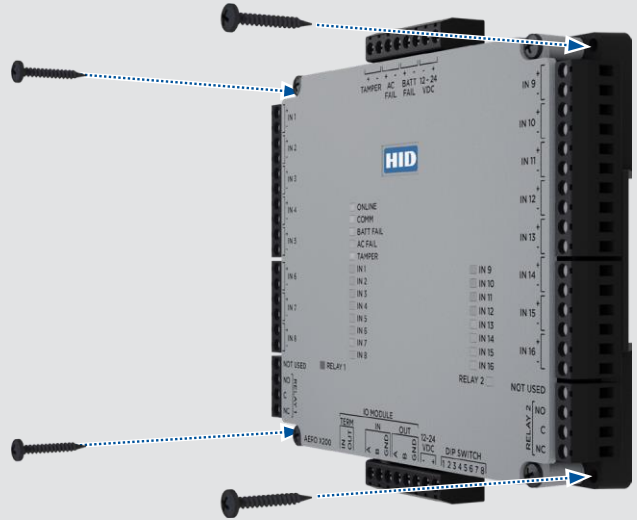

# 2. Communication wiring

Connect the X200 to the Aero X1100 intelligent controller using IO Module ports (2-wire RS-485).

Use 1-twisted pair, shielded cable, 120Ω impedance, 24 AWG, 4,000 ft. (1,219 m) maximum.



**Note:** Both **IN** and **OUT** terminals on the **IO MODULE** are the same port and are internally connected.

## Setting the termination jumpers

**Note:** Install RS-485 termination jumpers on the interface boards at each end of the communication bus only. Failure to do so will compromise the proper operation of the communication channel.

JUMPER	DESCRIPTION
IN	Install only on the first and last unit on the communication bus.
OUT	Install only if not the first or last unit on the communication bus.

### IO MODULE IN or IO MODULE OUT

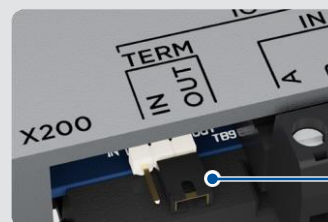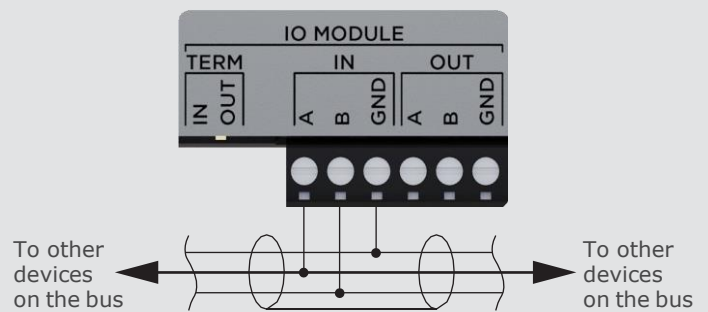

RS-485 termination jumper

### 3. Input circuit wiring

Inputs are typically used for the following:

- To monitor door position.
- Request to exit.
- Alarm contacts.


Input **IN 1** to **IN 16** circuits can be configured as unsupervised or supervised and can use normally open or normally closed contacts.

For a supervised circuit, add two 1K $\Omega$ , 1% resistors as close to the sensor as possible.


Custom end of line (EOL) resistances may be configured via the host software.

**Note:** The input circuit wiring configurations shown are supported but may not be typical.

Unsupervised circuit IN 1 to IN 16

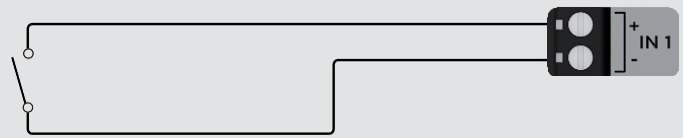

Supervised circuits IN 1 to IN 16

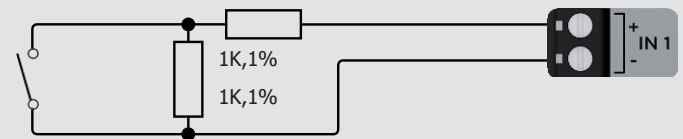

### 4. Relay circuit wiring

Two relays are provided for controlling door lock mechanisms or alarm signaling.

When controlling the delivery of power to the door strike, the **NO** (Normally Open) and **C** (Common) poles are typically used.


When momentarily removing power to unlock the door, as with a mag lock, the **NC** (Normally Closed) and **C** (Common) poles are typically used.

Check with local building codes for proper egress door installation.

**CAUTION**

**Door lock mechanisms can generate feedback to the relay circuit. This can cause damage and premature failure of the relay, effecting the operation of the X200. Use a diode to protect the relay. Use a wire of sufficient gauge to avoid voltage loss.**


DC Strike

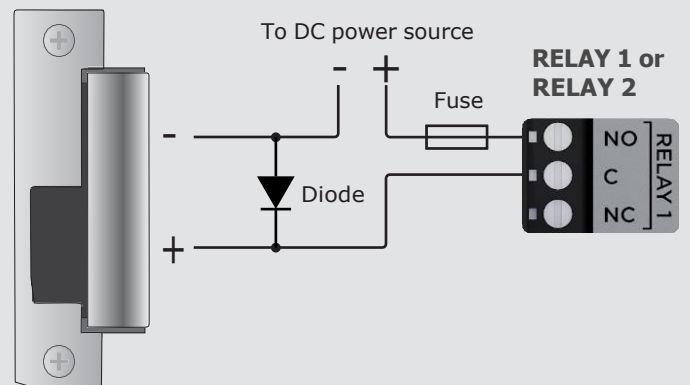

**Diode selection:**

- Diode current rating: 1x strike current.
- Diode breakdown voltage: 4x strike voltage.
- For 12 V DC or 24 V DC strike, diode 1N4002 (100V/1A) typical.

## 5. DIP switch configuration



Switches 1 through 5 select the device address. Switches 6 and 7 select the communication baud rate. Switch 8 is not in use.

1	2	3	4	5	6	7	8	SELECTION
OFF	OFF	OFF	OFF	OFF				Address 0
ON	OFF	OFF	OFF	OFF				Address 1
OFF	ON	OFF	OFF	OFF				Address 2
ON	ON	OFF	OFF	OFF				Address 3
OFF	OFF	ON	OFF	OFF				Address 4
ON	OFF	ON	OFF	OFF				Address 5
OFF	ON	ON	OFF	OFF				Address 6
ON	ON	ON	OFF	OFF				Address 7
OFF	OFF	OFF	ON	OFF				Address 8
ON	OFF	OFF	ON	OFF				Address 9
OFF	ON	OFF	ON	OFF				Address 10
ON	ON	OFF	ON	OFF				Address 11
OFF	OFF	ON	ON	OFF				Address 12
ON	OFF	ON	ON	OFF				Address 13
OFF	ON	ON	ON	OFF				Address 14
ON	ON	ON	ON	OFF				Address 15
OFF	OFF	OFF	OFF	ON				Address 16
ON	OFF	OFF	OFF	ON				Address 17
OFF	ON	OFF	OFF	ON				Address 18
ON	ON	OFF	OFF	ON				Address 19
OFF	OFF	ON	OFF	ON				Address 20
ON	OFF	ON	OFF	ON				Address 21
OFF	ON	ON	OFF	ON				Address 22
ON	ON	ON	OFF	ON				Address 23
OFF	OFF	OFF	ON	ON				Address 24
ON	OFF	OFF	ON	ON				Address 25
OFF	ON	OFF	ON	ON				Address 26
ON	ON	OFF	ON	ON				Address 27
OFF	OFF	ON	ON	ON				Address 28
ON	OFF	ON	ON	ON				Address 29
OFF	ON	ON	ON	ON				Address 30
ON	ON	ON	ON	ON				Address 31
					OFF	OFF		115,200 BPS
					ON	ON		38,400 BPS
					OFF	ON		19,200 BPS
					ON	OFF		9,600 BPS

## 6. Input power, cabinet tamper, and UPS fault input wiring


The X200 requires 12-24 V DC power. Connect power with minimum of 18 AWG wire.

**Connect the power ground to earth ground in only ONE LOCATION within the system. Multiple earth ground connections may cause ground loop problems and is not advised.**

**Observe POLARITY on 12-24 V DC input.**

Connect the **AC FAIL** and **BATT FAIL** inputs to the corresponding contacts provided on the power supply. Connect the **TAMPER** input to a tamper switch on the enclosure.

**TAMPER, AC FAIL, and BATT FAIL** connections are identical to inputs **IN 1** to **IN 16** and can be configured as unsupervised or supervised. *See step 3. Input circuit wiring.*

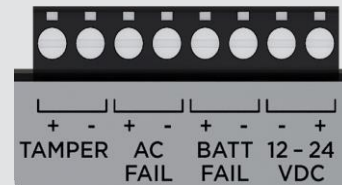

## Status LEDs

LED	POWER ON SELF-TEST	NORMAL OPERATION
<b>ONLINE</b>	ON then OFF	Heartbeat and Online status. Offline = 1 sec rate, 20% ON. Online encrypted comm .1 sec ON, .1 sec OFF, .1 sec ON, .1 sec OFF, .1 sec ON, .1 sec OFF, .1 sec ON, .3 sec OFF. Waiting for application download .1 sec ON, .1 sec OFF.
<b>COMM</b>	ON then OFF	RS-485 Comm status. Indicates communication activity on the SIO communication port.
<b>BATT FAIL</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>AC FAIL</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>TAMPER</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 1</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 2</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 3</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 4</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 5</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 6</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 7</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 8</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 9</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 10</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 11</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 12</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 11</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 14</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 15</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>IN 16</b>	ON then OFF	OFF = Inactive, ON = Active, Flash = Fault.*
<b>RELAY 1</b>	OFF	ON = Energized
<b>RELAY 2</b>	OFF	ON = Energized

\*If this input is defined, every three seconds the LED is pulsed to its opposite state for 0.1 seconds, otherwise, the LED is OFF.

## Specifications

<b>HID AERO X200</b>	
Input Voltage	12 to 24 V DC ±10%
Maximum Input Current	300 mA
IO Module	2-wire RS-485, 2,400 to 115,200 bps, asynchronous, half-duplex, 1 start bit, 8 data bits, and 1 stop bit
Inputs	19 unsupervised/supervised, standard EOL: 1k/1kΩ, 1%, ¼ watt (Includes TAMPER, AC FAIL, and BATT FAIL inputs) UL evaluation for access control use only
Output Relays	Two Form-C relays. Contact rating: 2 A @ 30 V DC resistive
<b>ENVIRONMENTAL</b>	
Operating Temperature	32 to 158°F (0 to +70°C)
Storage Temperature	-67 to 185°F (-55 to +85°C)
Humidity	5 to 85% RHNC
<b>MECHANICAL</b>	
Dimension	6.46" × 5.51" × 1.02" (164 mm × 140 mm × 26 mm)
Weight	326 g

These specifications are subject to change without notice.

